

PRE-INCIDENT SURVEY

2188 GPM

Building Name: Wesleyan Pentecostal Church Survey #: 68Street Address: 7656 US 264 E

City, State, Zip: _____

Primary Use: Church Construction Type: wood side built ordinary

Possible Entry: _____

Possible Occupancy: A.M. 75 P.M. _____ Sunday Services 10-4
- or more

Known Handicapped Personnel: _____

NOTIFY IN CASE OF EMERGENCYName: Pastor Dan Woods Name: Doug LAPPPhone: 402-5348 Phone: 945-3049974-0722**BUILDING CONSTRUCTION**Roof Type: Shingle Floor Construction: slab & joistRoof Construction: Wood rafters

Basement Construction Type: _____ Height of Basement: _____

Number of Stories: 2 Height of Each Story: 10

Length: _____ Width: _____ Height: _____

Attic Area: _____ Size: L _____ X W _____ X H _____

UTILITY TYPES

Gas: _____ Type: _____

Gas Shut Off Valve Location: _____

Electric: _____ Phase: _____

Panel Location: _____

Alarm Location: _____

EXPOSURES

North: _____ FT. West: _____ FT. South: _____ FT. East: _____

Type: _____ Type: _____ Type: _____ Type: _____

SUPPRESSION CRITERIA

Needed Fire Flow: _____ Total Water Supply: _____

Fuel Load: _____ Rate of Flow: _____

HYDRANT LOCATIONS

(1) _____ Flow: _____ Unit: _____

(2) _____ Flow: _____ Unit: _____

(3) _____ Flow: _____ Unit: _____

(4) _____ Flow: _____ Unit: _____

OTHER WATER RESOURCES

(1) _____

(2) _____

(3) _____

SPECIAL RESOURCES

(1) _____

(2) _____

(3) _____

MUTUAL AID

(1) _____ Assignment: _____

(2) _____ Assignment: _____

(3) _____ Assignment: _____

STAGING AREA


Primary: _____

Secondary: _____

MISCELLANEOUS INFORMATION

Sprinkler Connection: _____

Standpipe Connection: _____

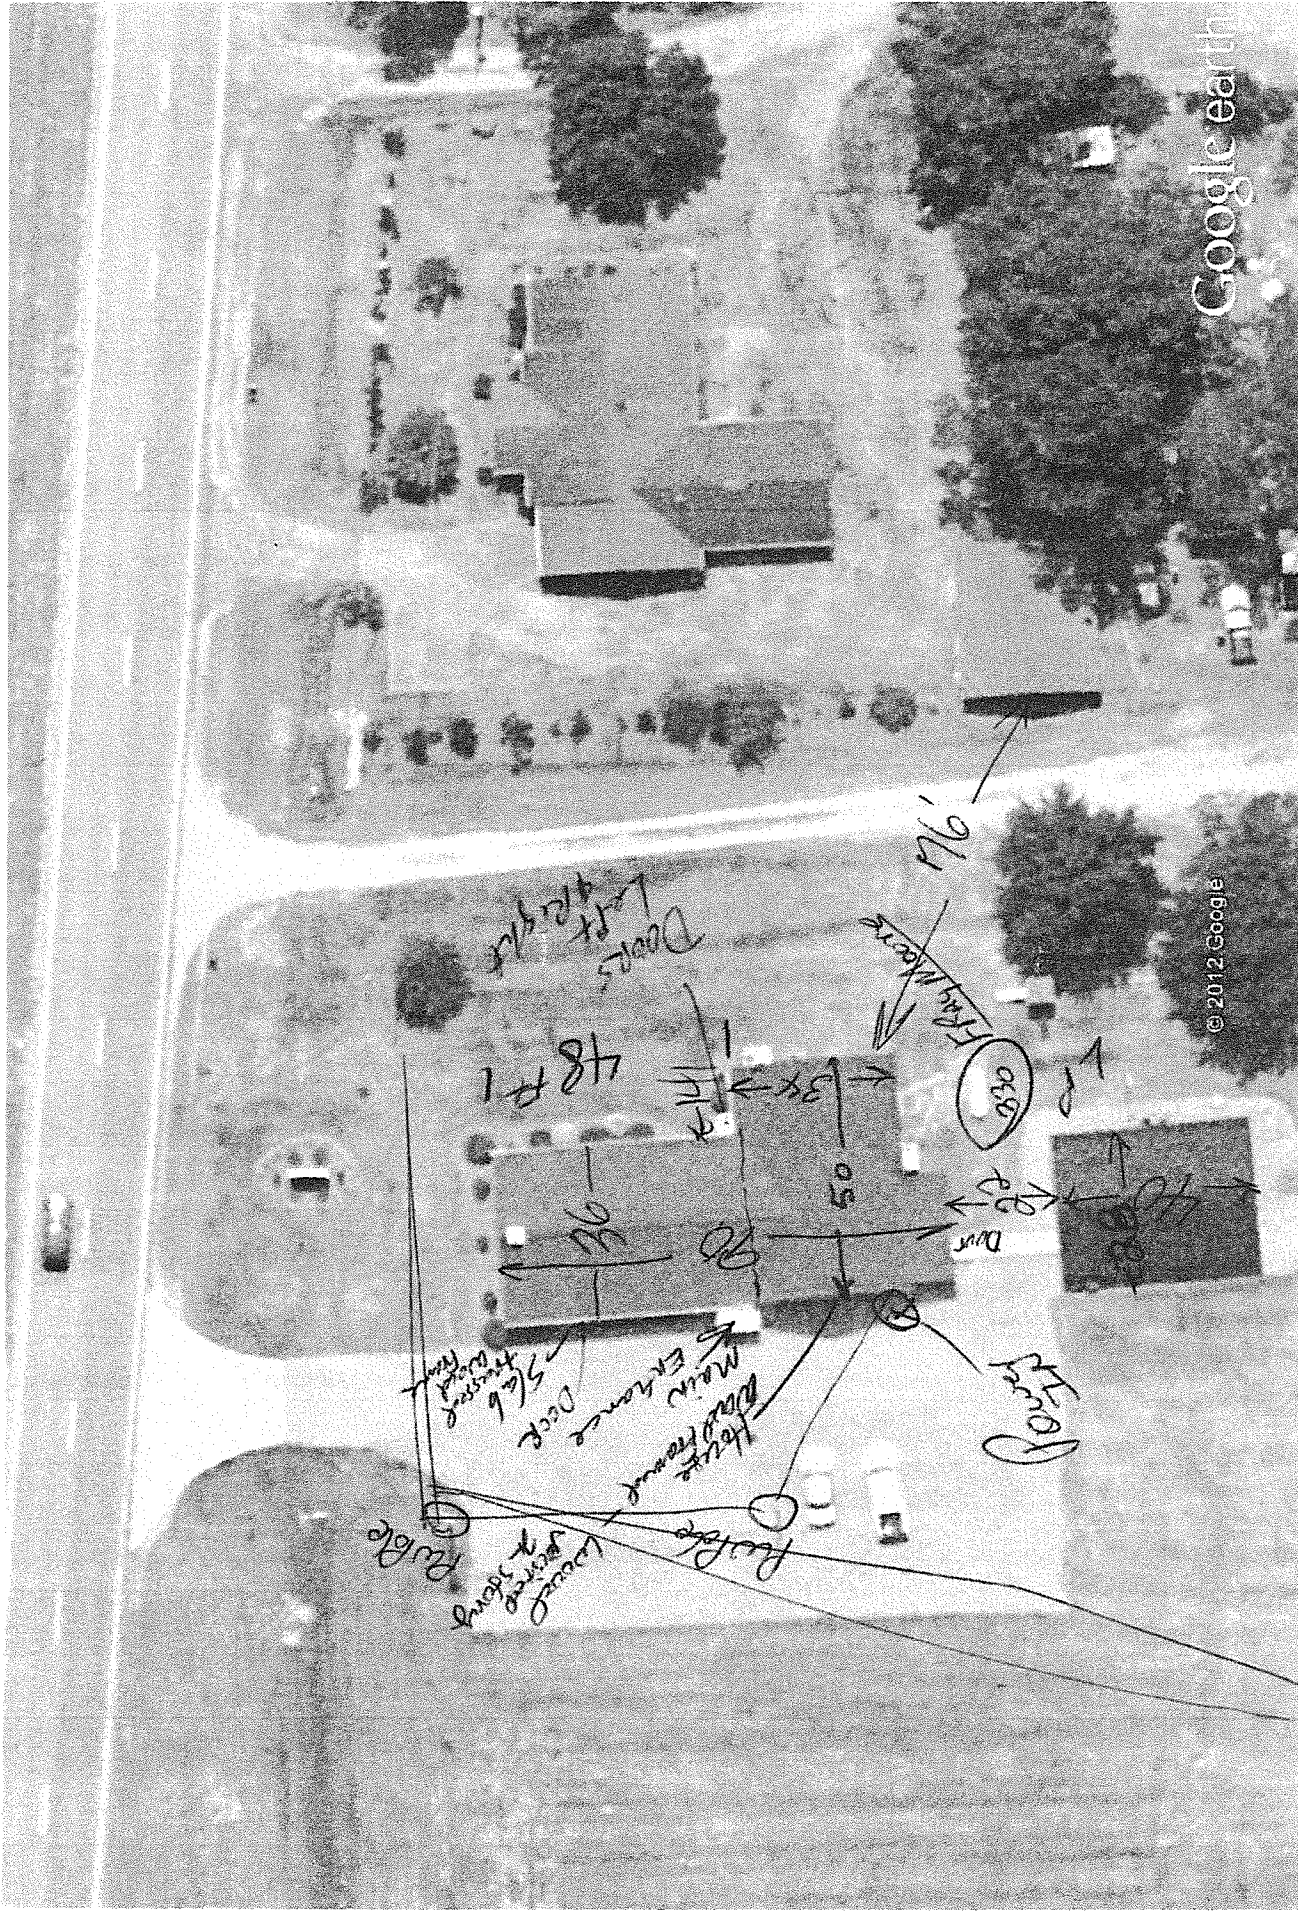

feet 200
meters 70

Wesleyan Pentecostal Church
7556 US 264 E

Structure Name Wesleyan Pontecostal Church
 Structure Address 7656 CES 264 E

Length	Width	Sq Ft	Sq Root	X 18	X construction type	GPM sum 1	X Occupancy	GPM sum 2
82	50	4100	64.03	1152.56	1.5	1728.84	0.85	1469.52

Exposure % add	Exposure add GPM	Exposure per side (75% max) Side A	Exposure per side 75% max Side B	Exposure per side 75% max Side C	Exposure per side 75% max Side D	Total GPM with exposures
25%	367.38		132	279	0	1880.52
19%	279.21					
14%	205.73					
9%	132.26					
75%	1102.14	Total A, B, C, D				
	MAX	411				

Round off to nearest 250 GPM for flows less than 2500 GPM, the nearest 500 GPM over 2500 GPM

Column F
Fire Resistive 0.6
Non-combustible 0.8
Ordinary 1
Wood Frame 1.5

Column H
 .75 if Mostly non-combustible contents
 .85 if Limited combustibles (apartments, churches, schools, hospitals)
 1.0 if Mostly combustible (restaurants, sheds, garages)
 1.15 if Free burning contents (post offices, horse stables, feed mills, repair garages, ag storage)
 1.25 if Rapid burning (aircraft hangers, tires, flammable liquids, wood working)

Total GPM with exposures	Add 50% for each floor above ground floor	# of floors above	Total to add for floors above	Sub-total with floors added	If wood shingles on roof add 500 GPM
1750.00	875	1	437.50	2187.50	0
				2187.50	2187.50

FIRE FLOW NEEDED
GPM
2187.50